



The Eimac YU-182 is a medium-Mu, forced air cooled, rugged ceramic/metal power triode intended for use as a power oscillator in industrial heating applications.



## CHARACTERISTICS<sup>1</sup>

### ELECTRICAL:

Filament: Thoriated Tungsten

Voltage..... 6.3 V

Current @ 6.3 volts..... 25 A

Direct Interelectrode Capacitances (grounded cathode)<sup>2</sup>

Cin..... 13 pF

Cout ..... 0.8 pF

Cgp ..... 8.5 pF

Amplification Factor, Average..... 24

Frequency of Maximum Ratings (CW)..... 100 MHz

### MECHANICAL:

Overall Dimensions:

Length ..... 5.6 in; 143 mm

Diameter ..... 3.925 in; 99.69 mm

Weight (approx.) ..... 2.75 lb; 1.25 kg

Operating Position..... Vertical, base up or down

Maximum Operating Temperatures:

Ceramic/Metal Seals & Envelope..... 250°C

Anode Core ..... 250°C

Cooling..... Forced Air

Base..... Special, Five Pin

Recommended Socket ..... EIMAC SK-410

<sup>1</sup> Characteristics and operating values are based upon performance tests. These figures may change without notice as the result of additional data or product refinement. CPI MPP Eimac Operation should be consulted before using this information for final equipment design.

<sup>2</sup> Capacitance values are for a cold tube as measured in a special shielded fixture in accordance with Electronic Industries Association Standard RS-191.

**RANGE VALUES FOR EQUIPMENT DESIGN**

	<b>Min.</b>	<b>Max.</b>	
<b>Filament Current @ 6.3 Volts</b> .....	<b>24.0</b>	<b>26.0</b>	<b>A</b>
<b>Interelectrode Capacitances<sup>1</sup> (grounded cathode)</b>			
<b>Cin</b> .....	<b>11.0</b>	<b>15.0</b>	<b>pF</b>
<b>Cgp</b> .....	<b>7.0</b>	<b>10.0</b>	<b>pF</b>
<b>Cout</b> .....	---	<b>1.0</b>	<b>pF</b>
<b>Cut-off Bias (Eb = 2.5 kV, Ib = 1.0 mA)</b> .....	<b>-115</b>	<b>-140.0</b>	<b>V</b>

<sup>1</sup> Capacitance values are for a cold tube as measured in a shielded fixture in accordance with Electronic Industries Association Standard RS-191.

**RADIO FREQUENCY POWER OSCILLATOR  
OR AMPLIFIER  
Class C**

**ABSOLUTE MAXIMUM RATINGS:**

Anode Voltage	7.0	Kilovolts DC
Anode Current	0.8	Ampere DC
Grid Voltage	- 500	Volts DC
Anode Dissipation	1.5	Kilowatts DC
Grid Dissipation	75	Watts
Grid Current, No Load	0.18	Ampere

**TYPICAL OPERATION:**

Anode Voltage	6.00	kVdc
Anode Current	0.65	Adc
Grid Voltage	-500	Vdc
Grid Current <sup>2</sup>	0.11	Adc
Peak Positive Grid Voltage	775	V
Driving Power	85	W
Plate Input Power	3900	W
Anode Dissipation	1.1	kW
Anode Output Power <sup>1</sup>	2.8	kW
Grid Resistance	4500	Ohms
Approximate Load Impedance*	4700	Ohms

<sup>1</sup> An output tank circuit efficiency of 88% is assumed.  
Power delivered to the load will vary with circuit losses.

<sup>2</sup> Approximate values.

**TYPICAL OPERATION**

NOTE: TYPICAL OPERATION data are obtained from direct measurement or by calculation from published characteristic curves. Adjustment of the rf grid voltage to obtain the specified anode current at the specified bias and anode voltages is assumed. If this procedure is followed, there will be little variation in output power when the tube is changed, even though there may be some variation in grid current. The grid current which results when the desired anode current is obtained is incidental and varies from tube to tube. These current variations cause no difficulty so long as the circuit maintains the correct voltage in the presence of the variations in current. If grid bias is obtained principally by means of a grid resistor, the resistor must be adjustable to obtain the required bias voltage when the correct rf grid voltage is applied.

**MECHANICAL**

**HANDLING** – This product contains a thoriated-tungsten filament and should be protected from shock and vibration. It is recommended that the tube be removed from equipment that is being shipped, to prevent damage that may occur in transit.

**MOUNTING & SOCKETING** – The tube must be operated with its axis vertical. The base of the tube may be up or down at the option of the equipment designer. This product contains a thoriated-tungsten filament and should be protected from shock and vibration. The Eimac SK-410 socket is ideal for use with this tube; other sockets may fail to provide proper airflow and pressure-drop characteristics and are not recommended. A cylindrically-shaped Teflon or glass chimney around the outside of the cooler is recommended for this purpose. Connection to the anode should be made by use of a band around the anode cooler.

**STORAGE** – If a tube is to be stored as a spare it should be kept in its original shipping carton with the original packing material to minimize the possibility of handling damage. Before storage a new tube should be operated in the equipment for 100 to 200 hours to establish that it has not been damaged and operates properly. If the tube is still in storage 6 months later it should be operated in the equipment for 100 to 200 hours to make sure there has been no degradation. If operation is satisfactory the tube can again be stored with great assurance of being a known-good spare.

**COOLING** - The maximum temperature rating for the anode core and the ceramic/metal seals of this tube is 250°C and sufficient forced-air cooling must be provided to assure operation at safe tube temperatures. Tube life is usually prolonged if cooling in excess of the absolute minimum requirements is provided.

Airflow must be applied anytime that filament voltage is applied to the tube and may continue for a period of approximately 2 minutes after filament voltage is removed to allow for tube cool-down. An interlock should be used that senses proper airflow and removes all power from the tube in the event of even partial cooling system failure.

The table below shows minimum airflow requirements necessary to keep the anode temperature below 225°C with an inlet air temperature of 250°C at sea level. Air-flow is specified to be in the base-to-anode direction. This data applies to operation below 30 MHz; if the tube is used above this frequency additional cooling may be required because of increased rf losses that occur at VHF.

Airflow Direction	Anode Dissipation Watts	Airflow CFM	Approximate Pressure Drop in H <sub>2</sub> O
Base to Anode	500	15	.09
Base to Anode	1000	34	.22
Base to Anode	1500	65	.45

At higher altitudes increased airflow is required; in this case both the airflow and pressure drop values shown must be increased by the following factors: 5000 feet x 1.24; 10,000 feet x 1.46. Additional cooling of the tube base may be required especially if the anode cooling air is not directed past the base first; the preferred configuration is airflow in the base-to-anode direction, although cooling air supplied in the alternate direction is permissible but must be of substantially higher flow rate to provide proper cooling.

The designer is cautioned that the cooling recommendations shown are absolute values for inlet air and temperature rise conditions shown with no safety factor; it is considered good engineering practice to allow additional air flow for conservatism and to make allowance for variables such as dirty air filters, dirty anode cooling fins, pressure losses in air ducting, etc. Cooling air should be filtered to remove particles of foreign matter that may become embedded in the anode cooling fins and impair cooling efficiency.

Temperature-sensitive paints are available which will allow a check of temperatures before any design is finalized. EIMAC Application Bulletin AB-20, "Measuring Temperature of Power Grid Tubes", covers this subject in detail and is available on request.

**ABSOLUTE MAXIMUM RATINGS** - Values shown for each type of service are based on the "absolute system" and are not to be exceeded under any service conditions. These ratings are limiting values outside which serviceability of the tube may be impaired. In order not to exceed absolute ratings the equipment designer has the responsibility of determining an average design value for each rating below the absolute value of that rating by a safety factor so that the absolute values will never be exceeded under any usual conditions of supply-voltage variation, load variation, or manufacturing variation in the equipment itself. It does not necessarily follow that combinations of absolute maximum ratings can be attained simultaneously.

**FILAMENT OPERATION** - This tube is designed for commercial service, with no more than one normal off/on filament cycle per day. If additional cycling is anticipated it is recommended the user contact Application Engineering at CPI/Eimac for additional information.

With a new tube, or one that has been in storage for some period of time, operation with filament voltage only, at the nominal value of 6.3 Volts, applied for a period of 30 to 60 minutes is recommended before full operation begins. This allows the active getter material mounted within the filament structure to absorb any residual gas molecules which have accumulated during storage.

Once normal operation has been established a minimum filament warm-up time of five seconds is normally sufficient before commencing operation at full power.

At the rated (nominal) filament voltage the peak emission capability of the tube is many times that needed for communications service. A reduction in filament voltage will lower the filament temperature, which will substantially increase life expectancy. The correct value of filament voltage should be determined for the particular application. It is recommended the tube be operated at full nominal voltage for an initial stabilization period of 100 to 200 hours before any action is taken to operate at reduced voltage. The voltage should gradually be reduced until there is a slight degradation in performance (such as power output or distortion). The voltage should then be increased a few tenths of a volt above the value where performance degradation was noted for operation. The operating point should be rechecked after 24 hours. Filament voltage should be closely regulated when voltage is to be reduced below nominal in this manner, to avoid any adverse influence by normal line voltage variations. Filament voltage should be measured at the tube base or socket, using an accurate rms-responding meter.

Eimac Application Bulletin AB-18, "Extending Transmitter Tube Life", gives information on the effect of filament voltage on life expectancy.

When cold, the resistance of a thoriated tungsten filament is very low, therefore the initial starting (inrush) current when filament voltage is applied can be many times the normal (hot) current; this can be detrimental to the longevity of a filament structure. Filament inrush current should never exceed a value of twice the nominal rated current. The use of a special impedance-limited filament transformer or other "step-start" circuitry in the supply side (primary) of the filament transformer is recommended.

**LOAD FAULTS** - In self-excited oscillators large load variations or faults can cause potentially dangerous changes in tube efficiency, which in turn, can increase anode dissipation to a very high level. If this occurs, tube damage can result even though the anode current is near normal operating values. The circuit designer is therefore cautioned to suitably proportion the circuit constants to minimize this effect, and to be sure cooling airflow is adequate to handle the worst-case dissipation conditions. New system designs often incorporate a thermal detection device in the exhaust airflow to remove power from the tube in the case of abnormal or fault conditions.

**GRID OPERATION** - In class C service a resistor in the dc grid return can be employed to obtain the desired grid bias voltage. In self-excited oscillators that use this technique, special care should be taken to assure that under no conditions will grid current fall to zero or very low values, as may occur if oscillations cease while plate voltage is present, otherwise anode overheating may occur.

When a power grid tube in an oscillator is lightly loaded, grid current will rise. This will increase bias voltage somewhat, helping reduce anode current and therefore lower anode dissipation. Grid dissipation however may rise under these conditions, and it is important to respect the maximum no-load grid current rating for the YU-182, specifically 0.18 Ampere.

This value should never be exceeded except for brief intervals during tuning. In all circumstances grid current must be monitored continuously with a dc current meter. Use of a dynamic resistance such as an incandescent lamp as part of the grid resistance is sometimes employed in power oscillators to help reduce load-pulling effects associated with some applications.

The maximum grid dissipation rating for this tube is 75 Watts, determined approximately by the product of the dc grid current and the peak positive grid voltage. A grid current sensing circuit which removes anode voltage from the tube in the event of excessive grid current is recommended. A protective spark-gap device should be connected between the grid and cathode to guard against excessive voltage.

**FAULT PROTECTION** - In addition to normal cooling interlocks, grid and anode over-current interlocks, it is good practice to protect the tube from internal damage which could result from occasional arcing at high plate voltage. In all cases, some protective resistance, at least 10 Ohms, should be used in series with the tube's anode supply to absorb power supply stored energy in case an arc should occur. An electronic crowbar, which will discharge power supply capacitors in a few microseconds after the start of an arc, may be required. The test for each electrode supply is to short each electrode to ground, one at a time, through a vacuum relay switch and a 6-inch length of #30 AGW copper wire. The wire will remain intact if protection is adequate. Eimac Application Bulletin AB-17, "Fault Protection", contains considerable detail and is available upon request.

**INTERELECTRODE CAPACITANCE** - The actual internal interelectrode capacitance of a tube is influenced by many variables in most applications, such as stray capacitance to the chassis, capacitance added by the socket used, stray capacitance between tube terminals, and wiring effects. To control the actual capacitance values within the tube, as the key component involved, the industry and the Military Services use a standard test procedure as described in Electronic Industries Association Standard RS-191. This requires the use of specially constructed test fixtures, which effectively shield all external tube leads from each other and eliminates any capacitance reading to "ground". The test is performed on a cold tube in a special shielded test fixture. Other factors being equal, controlling internal tube

capacitance in this way normally assures good interchangeability of tubes over a period of time, even with tubes made by different manufacturers. Capacitance values shown in the manufacturer's technical data, or test specifications, normally are taken in accordance with Standard RS-191.

The equipment designer is therefore cautioned to make allowance for the actual capacitance values which will exist in any normal application. Measurements should be taken with mounting which represents approximate final layout if capacitance values are highly significant in the design.

**HIGH VOLTAGE** - The YU-182 operates at voltages which can be deadly, and the equipment must be designed properly and operating precautions must be followed. Equipment must be designed so that no one can come in contact with high volt-

ages. All equipment must include safety enclosures for high-voltage circuits and terminals, with interlock switches to open the primary circuits of the power supplies and to discharge high-voltage capacitors whenever access doors are opened. Interlock switches must not be bypassed or "cheated" to allow operation with access doors open. Always remember that **HIGH VOLTAGE CAN KILL**.

**HOT SURFACES** - Air-cooled surfaces and other parts of tubes can reach temperatures of several hundred degrees C and cause serious burns if touched for several minutes after all power is removed.

**SPECIAL APPLICATIONS** - If it is desired to operate this tube under conditions widely different from those given here, contact the Application Engineering Dept., CPI MPP Eimac Operation for information and recommendations.

## OPERATING HAZARDS

Proper use and safe operating practices with respect to power tubes are the responsibility of equipment manufacturers and users of such tubes. All persons who work with and are exposed to power tubes, or equipment that utilizes such tubes, must take precautions to protect themselves against possible serious bodily injury. **DO NOT BE CARELESS AROUND SUCH PRODUCTS.**

The operation of this tube may involve the following hazards, any one of which, in the absence of safe operating practices and precautions, could result in serious harm to personnel.

Please review the detailed Operating Hazards Sheet enclosed with each tube, or request a copy from CPI Microwave Power Products, Eimac Operation.

**HIGH VOLTAGE** – Normal operating voltages can be deadly. Remember the **HIGH VOLTAGE CAN KILL**.



**LOW-VOLTAGE HIGH-CURRENT CIRCUITS** - Personal jewelry, such as rings, should not be worn when working with filament contacts or connectors as a short circuit can produce very high current and melting, resulting in severe burns.

**RF RADIATION** – Exposure to strong rf fields should be avoided, even at relatively low frequencies. **CARDIAC PACEMAKERS MAY BE AFFECTED.**

**HOT WATER** – Water used to cool tubes may reach scalding temperatures. Touching or rupture of the cooling system can cause serious burns.


**HOT SURFACES** – Surfaces of tubes can reach temperatures of several hundred°C and cause serious burns if touched for several minutes after all power is removed.

**MATERIALS COMPLIANCE** - This product and package conforms to the conditions and limitations specified in 49CFR 173.424 for radioactive material, excepted package-instruments or articles, UN2910. In addition, this product and package contains no beryllium oxide (BeO).

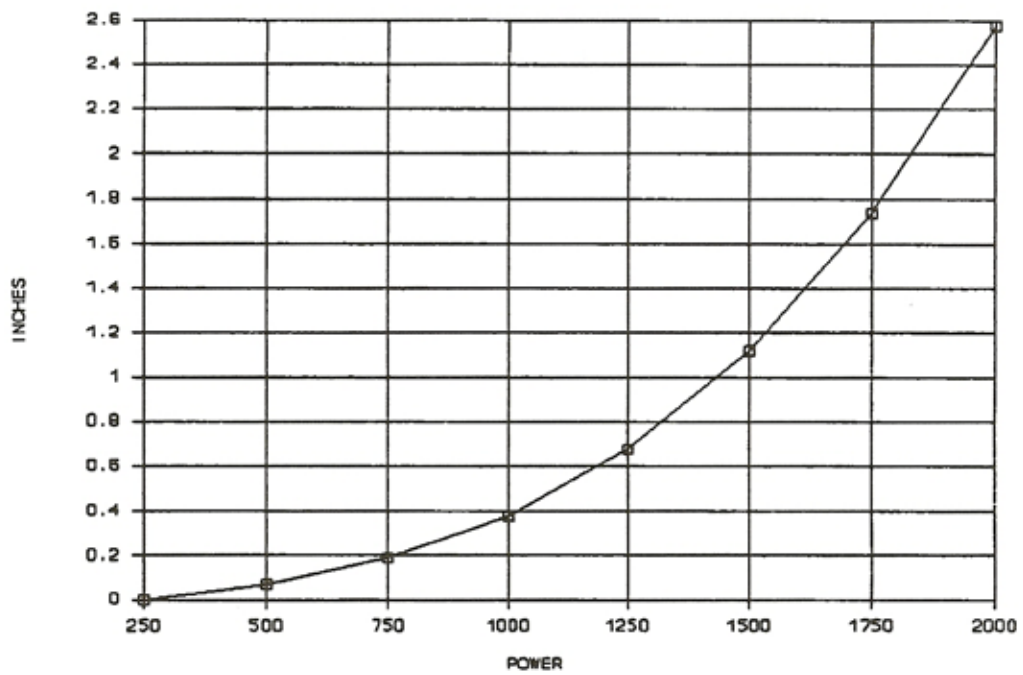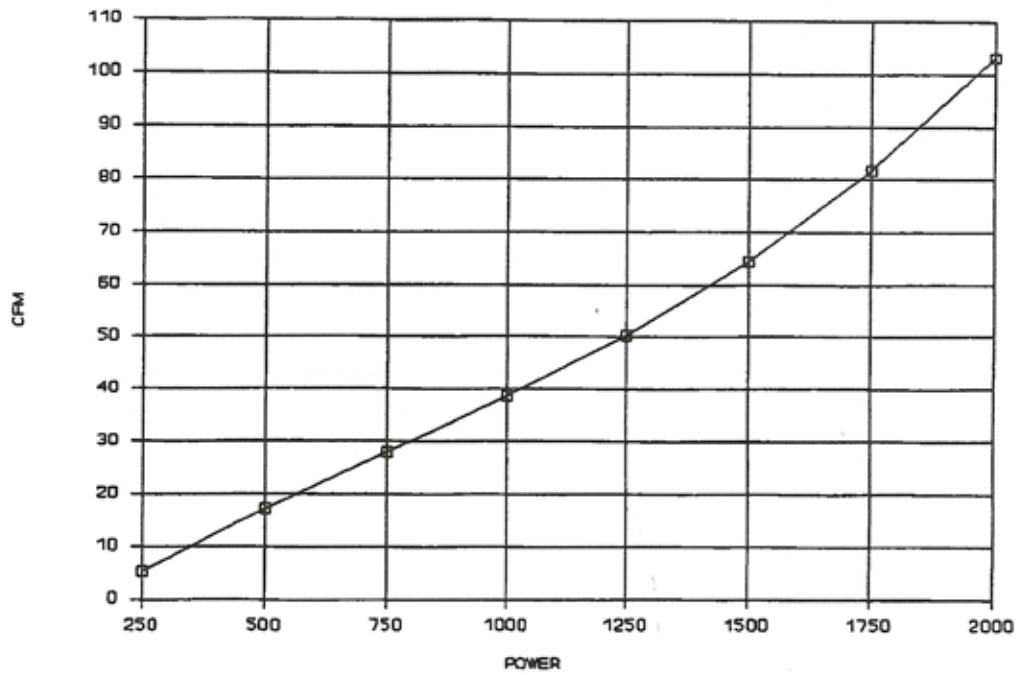

COOLING YU-182

Air flow was measured using the SK-410 socket and a chimney 6 inches in diameter which allowed for a clearance of 1 inch around the anode of the tube. The chimney does not come in direct contact with the anode of the tube.

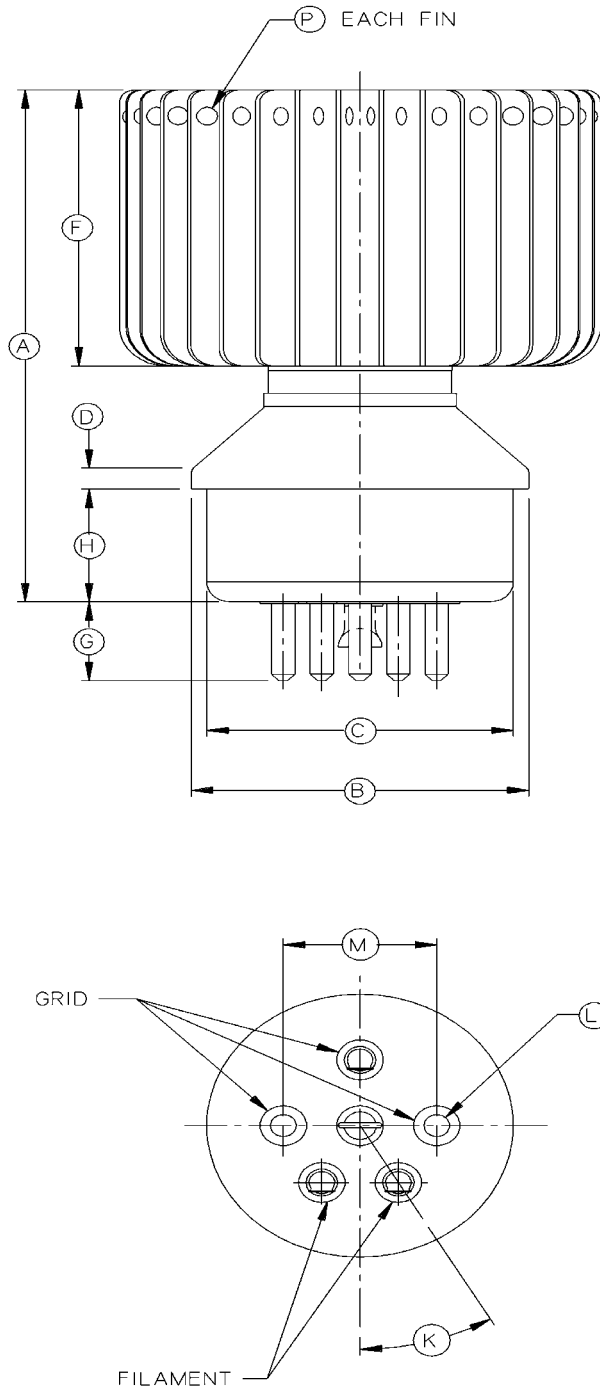

DIM.	INCHES			MILLIMETERS		
	MIN.	MAX.	REF.	MIN.	MAX.	REF.
A		4.750			120.65	
B			2.750			69.85
C			2.500			63.50
D			.212			5.38
F			2.625			66.68
G	.700	.800		17.78	20.32	
H			1.070			27.18
K			30°			
L	.185	.191		4.70	4.85	
M			1.250			31.75
N			3.925			99.70
P	.165			4.19		

**NOTE:**

1. REFERENCE DIMENSIONS ARE FOR INFORMATION ONLY AND ARE NOT REQUIRED FOR INSPECTION PURPOSES

